


Product Group Subject	Calenta Solo, Calenta Double Solo and Calenta with internal calorifier Summer Mode - Improved control algorithm PCU-02 / PCU-03
Number	20110324-01
Introduction / Change Order Number	10444
Introduction Date	03-2011
Introduction Serial Number	1105401775260


Description former situation

During the summer period when there is no heat demand for Central Heating we have recognized the following effect. After a DHW request the three way valve is returning to the central heating position. During this switch over the pump keeps running. This causes a small flow of hot water in the central heating system.

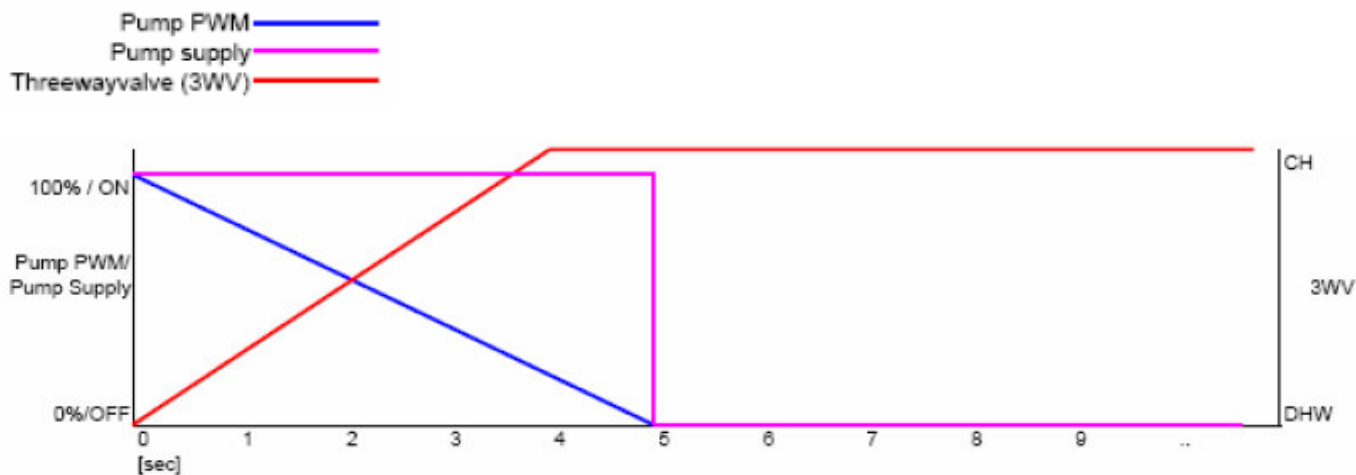

New situation

Switching off the pump before the 3 way valve is opened will reduce the warm water flow into the central heating system to a minimum.

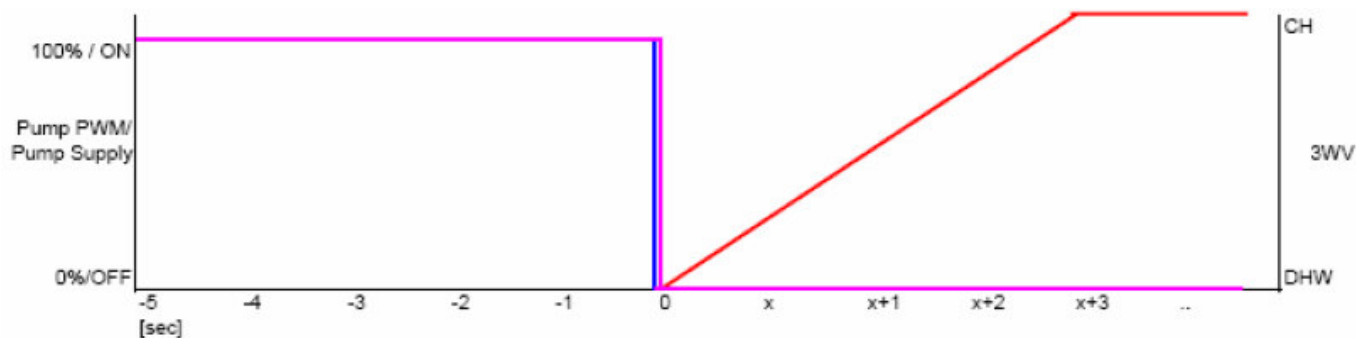

Article Number

The spare part article of PCU-03 has not been changed: S101478. This is the general spare part for all Calenta boilers (see also Technical Information Bulletin 20110204-01).

Remarks & Questions

service.export@remeha.nl